



Line 5 Wisconsin Segment Relocation Project


Wisconsin Department of Natural Resources

Docket # IP-NO-2020-2-N00471


Enbridge Reponses to DNR Information Request Dated March 10, 2023

Attachment 11

Dam and Pump Water Intake Screening Typical

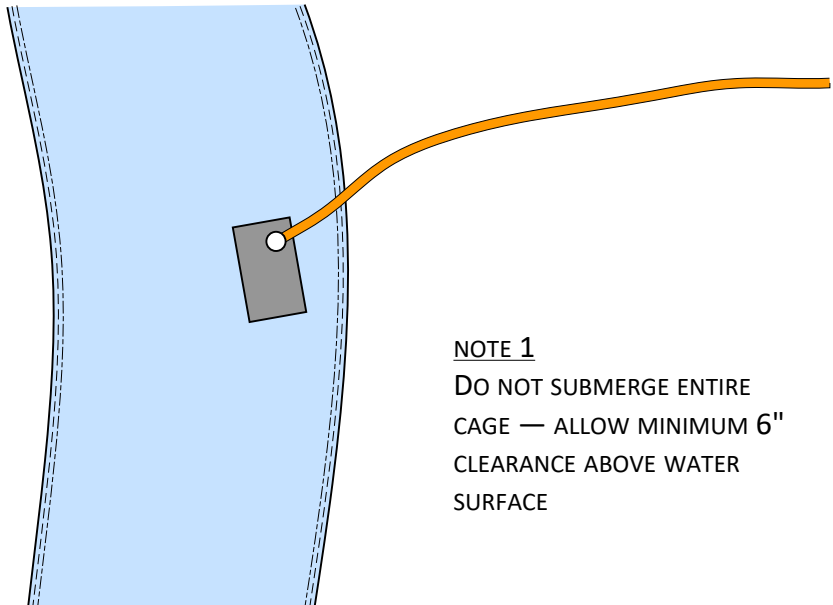

NOTE 1
DO NOT SUBMERGE ENTIRE
CAGE — ALLOW MINIMUM 6"
CLEARANCE ABOVE WATER
SURFACE

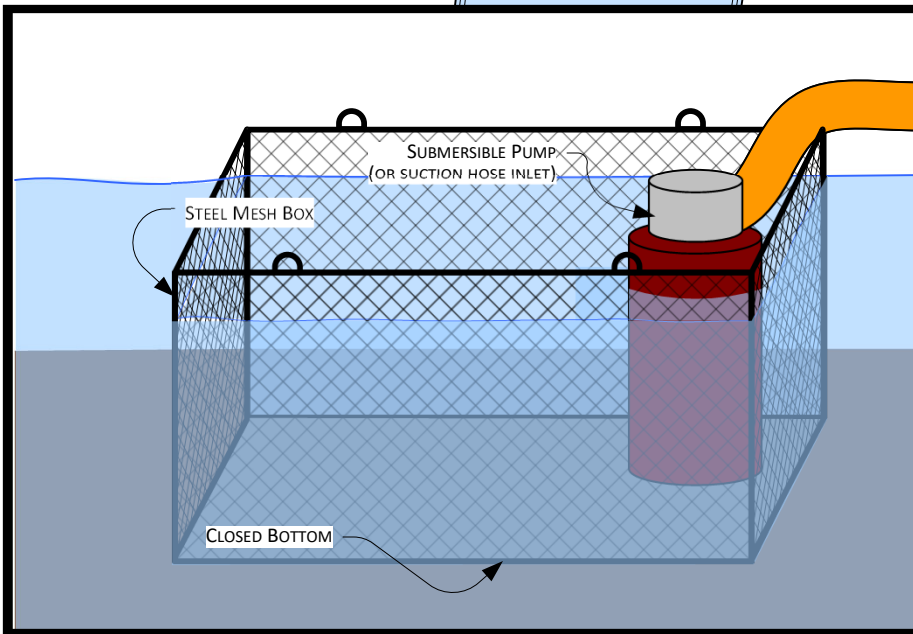

NOTE 2
DO NOT OBSTRUCT MAIN
CHANNEL FLOW

NOTE 3
SCREEN SIZE: 3/16"

For environmental review purposes only.



Dam and Pump Intake Screening Typical
Line 5 Wisconsin Segment Relocation Project
Enbridge Energy, LLC

